


DEPTH AS DETERMINED BY
APPROPRIATELY QUALIFIED SOILS
ENGINEER, HAVING REGARD FOR
PROPOSED DESIGN PAVEMENT
AND EXISTING SOIL CONDITIONS

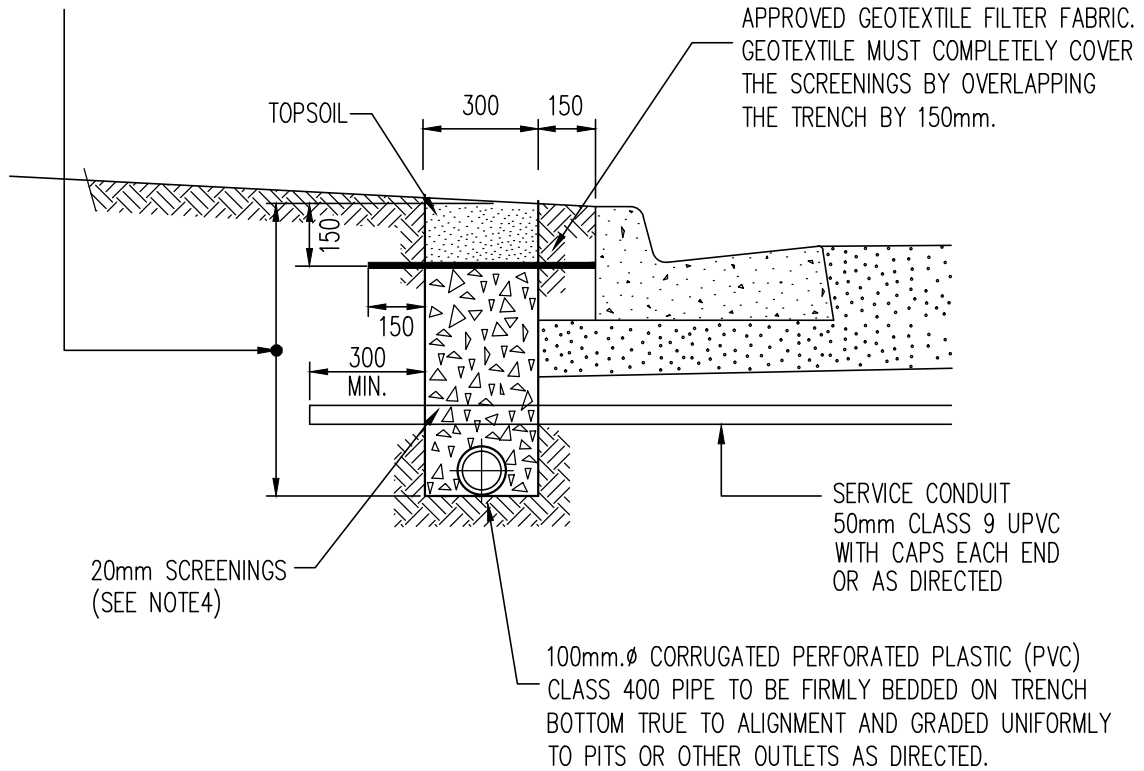

LOCATION OF SUBSOIL DRAINAGE PIPE

SCALE 1:20

NOTES

1. DEFLECT TRENCH OVER LAST 2.0m TO CONNECT TO PITS
2. A.G. DRAIN TO BE A MINIMUM OF 25mm CLEAR BELOW SERVICE CONDUITS
3. A.G. DRAINS TO BE LOCATED BEHIND KERB AND CHANNEL
4. BACKFILL TO BE:
 - (i) 20mm SCREENINGS
 - (ii) 20mm CLEAN SCORIA
 - (iii) 20mm RECYCLED CONCRETE WITH NO FINES
 - (iv) 20mm NO FINES CONCRETE



GREATER DANDENONG

**SUBSOIL DRAINAGE
NEW WORKS**

LAST UPDATED – SEPTEMBER 2014

INFRASTRUCTURE PLANNING

SD 226–A